



LEGEND

- MANUAL PULL STATION
- STANDPIPE HOSE OUTLET
- FIRE WARDEN STATION
- FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SAMESE CONNECTION)
- STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)


NO.	DATE	REVISION	REVISION DESCRIPTION
1	03.01.18	001	REVISION FOR SUBMITAL TO LDC
2	04.04.18	001	REVISION FOR SUBMITAL TO LDC
3	04.04.18	001	REVISION FOR SUBMITAL TO LDC
4	04.04.18	001	REVISION FOR SUBMITAL TO LDC
5	04.04.18	001	REVISION FOR SUBMITAL TO LDC
6	04.04.18	001	REVISION FOR SUBMITAL TO LDC
7	04.04.18	001	REVISION FOR SUBMITAL TO LDC
8	04.04.18	001	REVISION FOR SUBMITAL TO LDC
9	04.04.18	001	REVISION FOR SUBMITAL TO LDC
10	04.04.18	001	REVISION FOR SUBMITAL TO LDC

DRAWN BY/DATE: **RM** CHECKED BY/DATE: **DL**

BUILDING ADDRESS:
150 WEST 30TH ST
NEW YORK, NY 10001

DRAWING TITLE:
FL-13
13TH FLOOR

SURVEY BY: **AR** SURVEY DATE: **09.15.20**

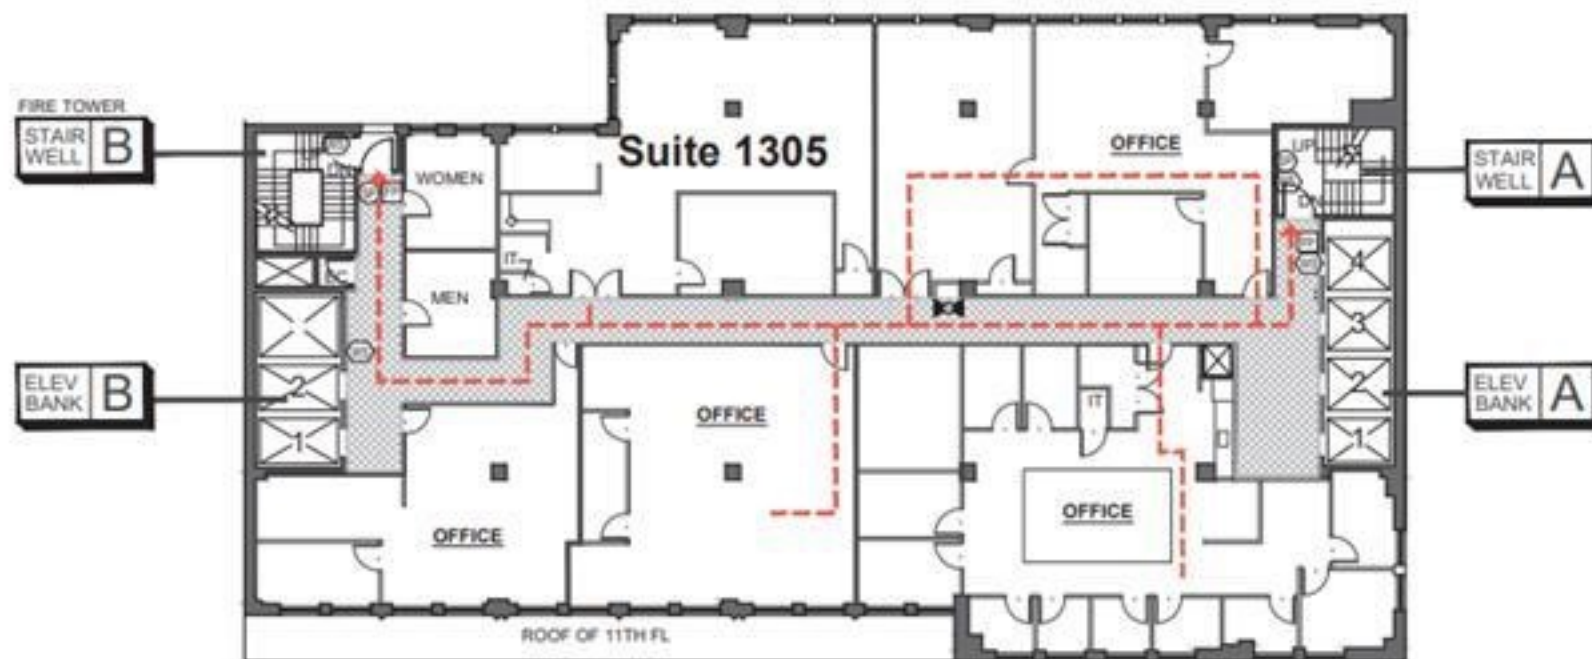

WEST 30TH STREET

NOTE: FULL SPRINKLER COVERAGE