



Building Engines
DISCLAIMER: THESE DRAWINGS WERE CREATED FOR EAP AND/OR FIRE SAFETY FILING ONLY. DRAWINGS ARE NOT TO SCALE & SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. EXISTING CONDITIONS MAY VARY.

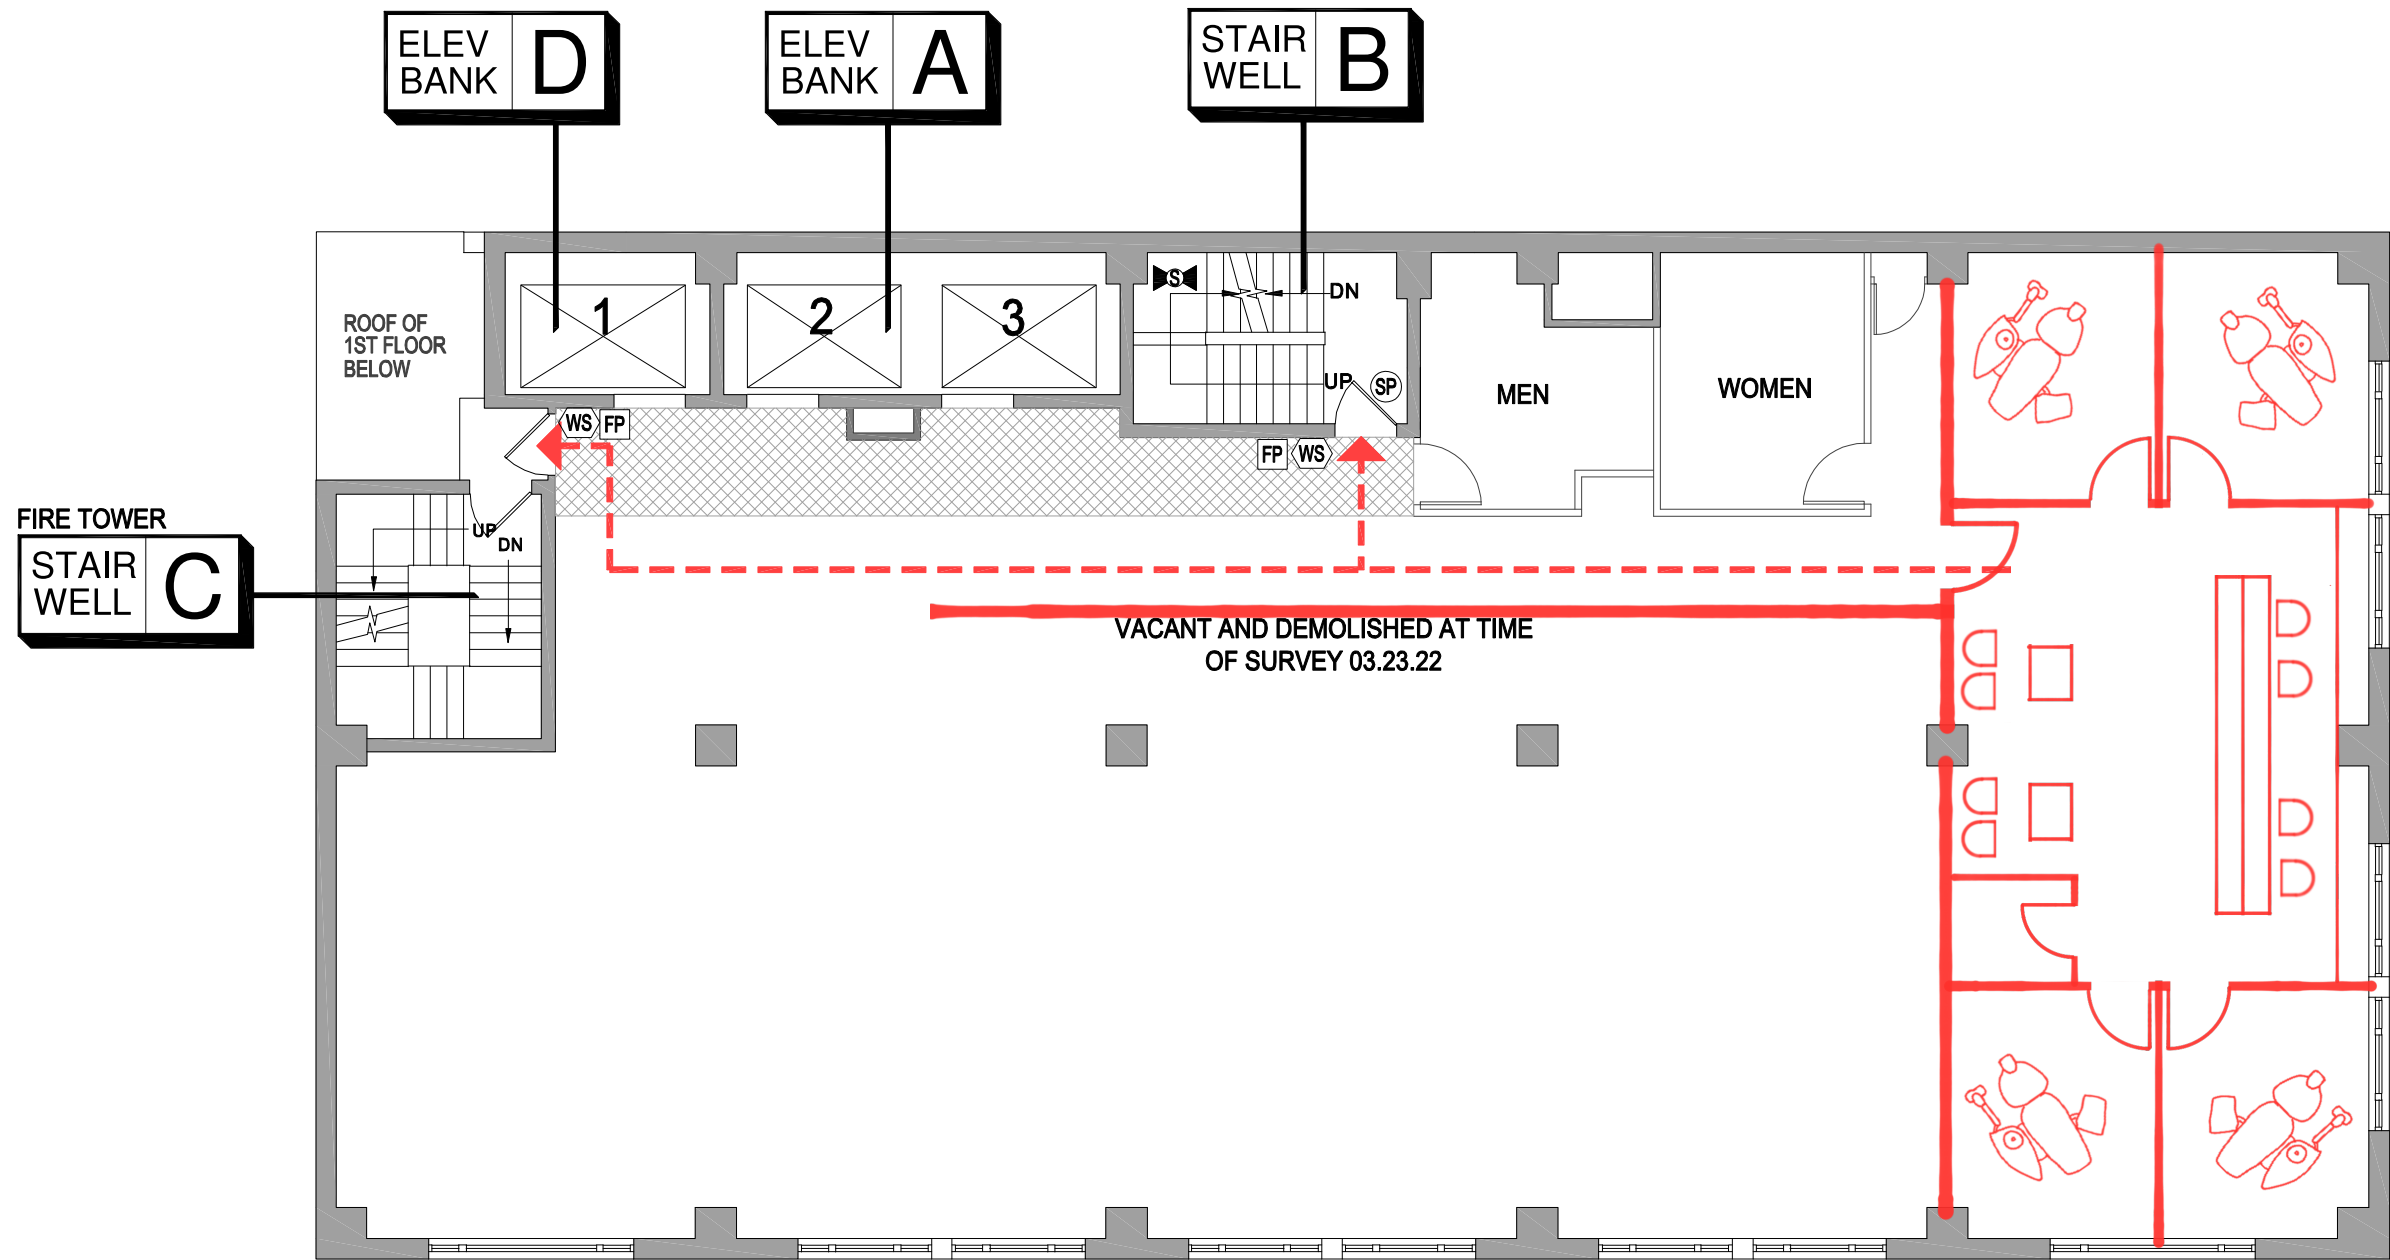

LEGEND

- FP** MANUAL PULL STATION
- SP** STANDPIPE HOSE OUTLET
- WS** FIRE WARDEN STATION
- FCS** FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)**
- SP** STANDPIPE CONTROL VALVE
- S** SPRINKLER CONTROL VALVE
- D** DOMESTIC WATER MAIN CONTROL VALVE
- EVACUATION ROUTE**
- FURNITURE/EQUIPMENT**
- NON-RATED PARTITION**
- FIRE BARRIER**
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)**
- IN-BUILDING RELOCATION AREAS (IBRA)**

NO.	DATE:	NAME:	ISSUED/ COMMENTS:
1	03.28.22	JG	UPDATED 1ST DRAFT ISSUED FOR REVIEW

DRAWN BY/DATE: GH	CHECKED BY/DATE: XX/XX
----------------------	---------------------------

BUILDING ADDRESS:
136 EAST 57TH ST
NEW YORK, NY 10022
"THE BLANK HOTEL"

DRAWING TITLE:
FL-4
4th Floor

SURVEY BY: JG	SURVEY DATE(S): 03.23.22
------------------	-----------------------------

EAST 57TH STREET

FULL SPRINKLER COVERAGE.
TEMP. SPRINKLER LOOP