


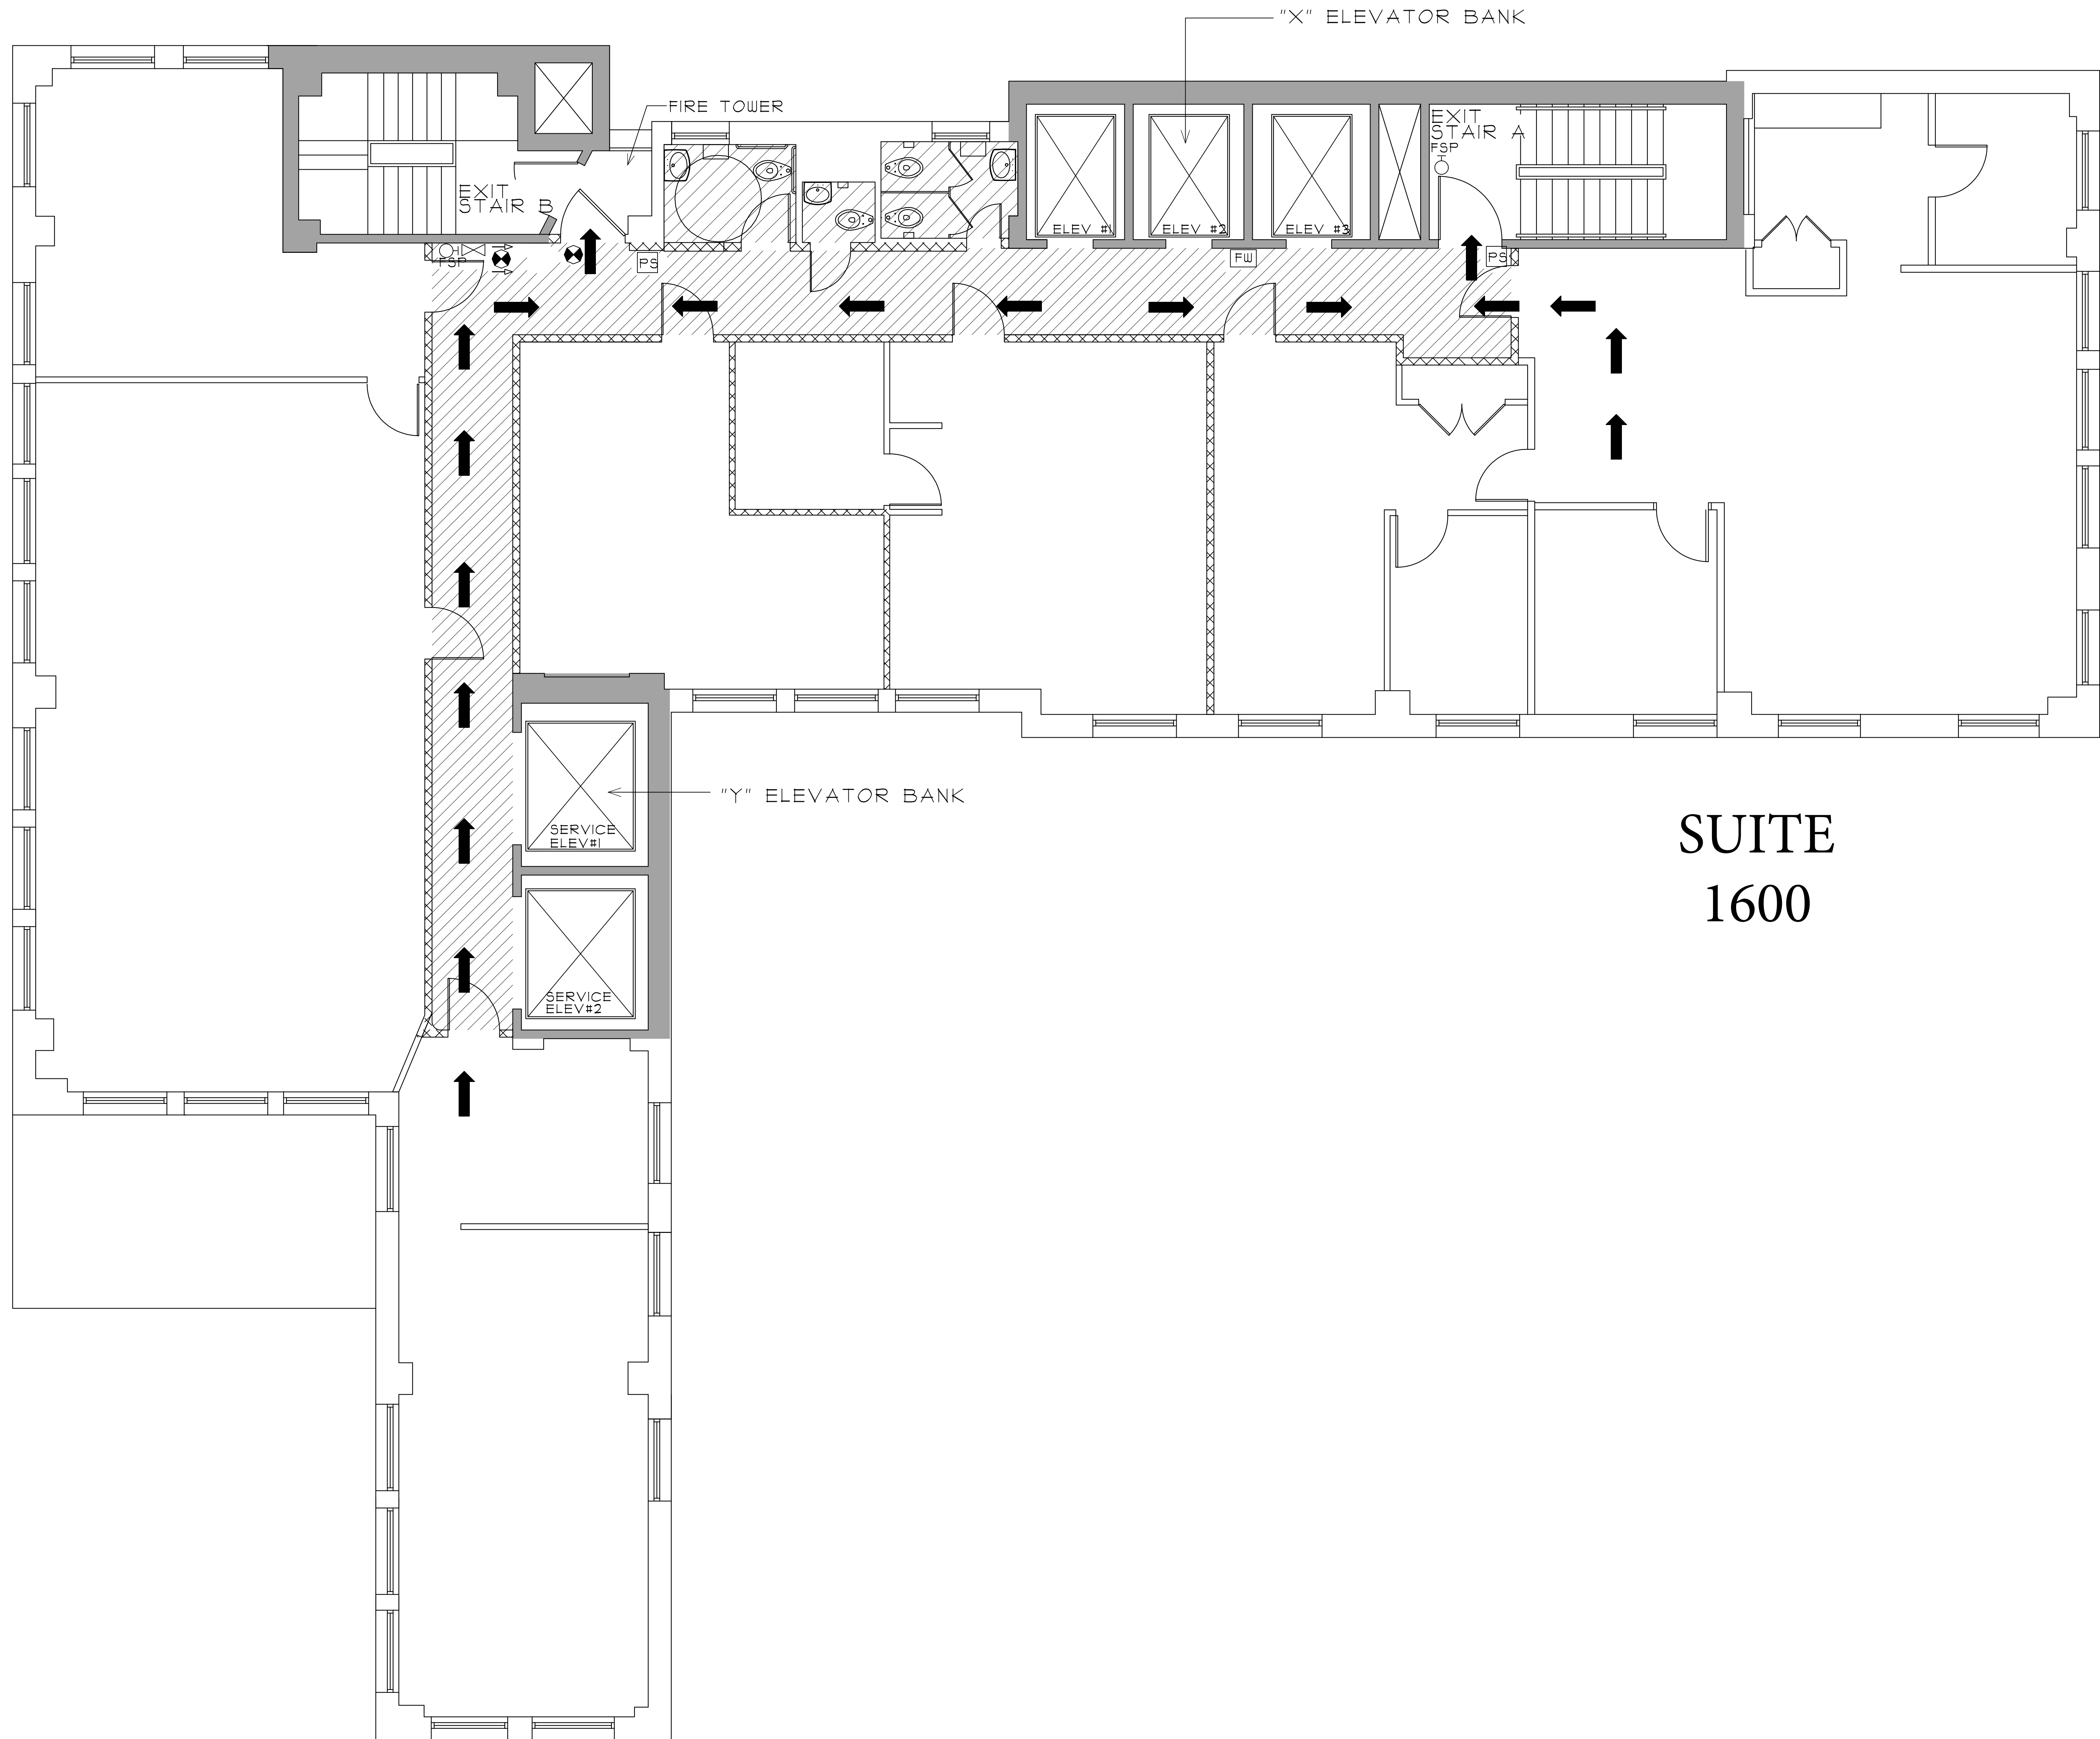


LEGEND

PULL STATION	PS
FIRE WARDEN	FW
SIAMESE CONNECTION	V
FIRE STANDPIPE	FSP
IN-BUILDING RELOCATION AREA	▨
FIRE COMMAND STATION	FCS
EXIT ROUTE	➔
WALL MOUNTED EXIT SIGN WITH ARROWS POINTING TO DIRECTION OF EXIT	⬆
SPRINKLER CONTROL VALVE	X
PARTITION TYPES	
2 HOUR FIRE RATING	▬
1 HOUR FIRE RATING	▨
NOTE: ALL PARTITION FIRE RATING ARE ASSUMED	

SUITE
1600

SEVENTH AVENUE

NO.	DATE	
PROJECT		
 GRASSO-MENZIUOSO ARCHITECTS A.I.A. 350 SEVENTH AVENUE, N.Y., N.Y., 10001 TEL: (212) 779-0257 FAX: (212) 779-9648		
STRUCTURAL ENGINEER		
MECHANICAL ENGINEER		
TITLE:		PROJECT NO. 8031
14TH FLOOR		DATE 1/29/09
		SCALE: 1/4"=1'-0"
LOCATION:		DWG BY:
350 SEVENTH AVENUE		
NEW YORK, NEW YORK		FL-16
ALL RIGHTS RESERVED		
ALL DRAWINGS, SPECIFICATIONS AND COPIES THEREOF PROVIDED BY THE ARCHITECT ARE AND SHALL REMAIN THEIR PROPERTY. THEY ARE NOT TO BE USED ON THIS OR ANY OTHER PROJECT UNLESS WRITTEN PERMISSION IS GIVEN BY G. M. ARCHITECTS.		

