


FIRE TOWER  
STAIR WELL B

ELEV BANK B

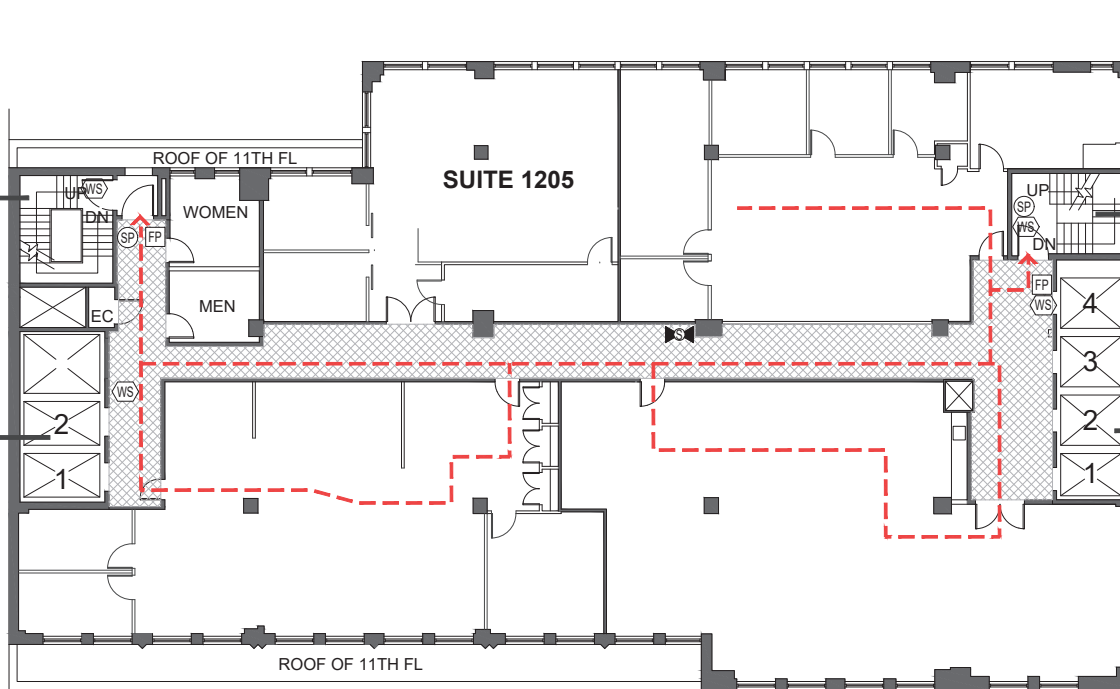

## LEGEND

FP	MANUAL PULL STATION
SP	STANDPIPE HOSE OUTLET
WS	FIRE WARDEN STATION
FCS	FIRE COMMAND STATION
	FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
	STANDPIPE CONTROL VALVE
	SPRINKLER CONTROL VALVE
	DOMESTIC WATER MAIN CONTROL VALVE
	EVACUATION ROUTE
	FURNITURE/EQUIPMENT
	NON-RATED PARTITION
	FIRE BARRIER
	NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
	IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE	NAME	ISSUED/ COMMENTS
1	10.01.20	MB	REVISED PER SURVEY 08.15.20 ISSUED FOR REVIEW AND FILING
2	10.08.20	JW	REVISED PER COMMENTS ISSUED FOR REVIEW

DRAWN BY/DATE: KM  
CHECKED BY/DATE: DL

BUILDING ADDRESS:  
150 WEST 30TH ST  
NEW YORK, NY 10001

DRAWING TITLE:  
**FL-12**  
12TH FLOOR

SURVEY BY: AR  
SURVEY DATE(S): 09.15.20

WEST 30TH STREET

NOTE: FULL SPRINKLER COVERAGE