


DISCLAIMER: THESE DRAWINGS WERE CREATED FOR EAP AND/OR FIRE SAFETY FILING ONLY. DRAWINGS ARE NOT TO SCALE & SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. EXISTING CONDITIONS MAY VARY.

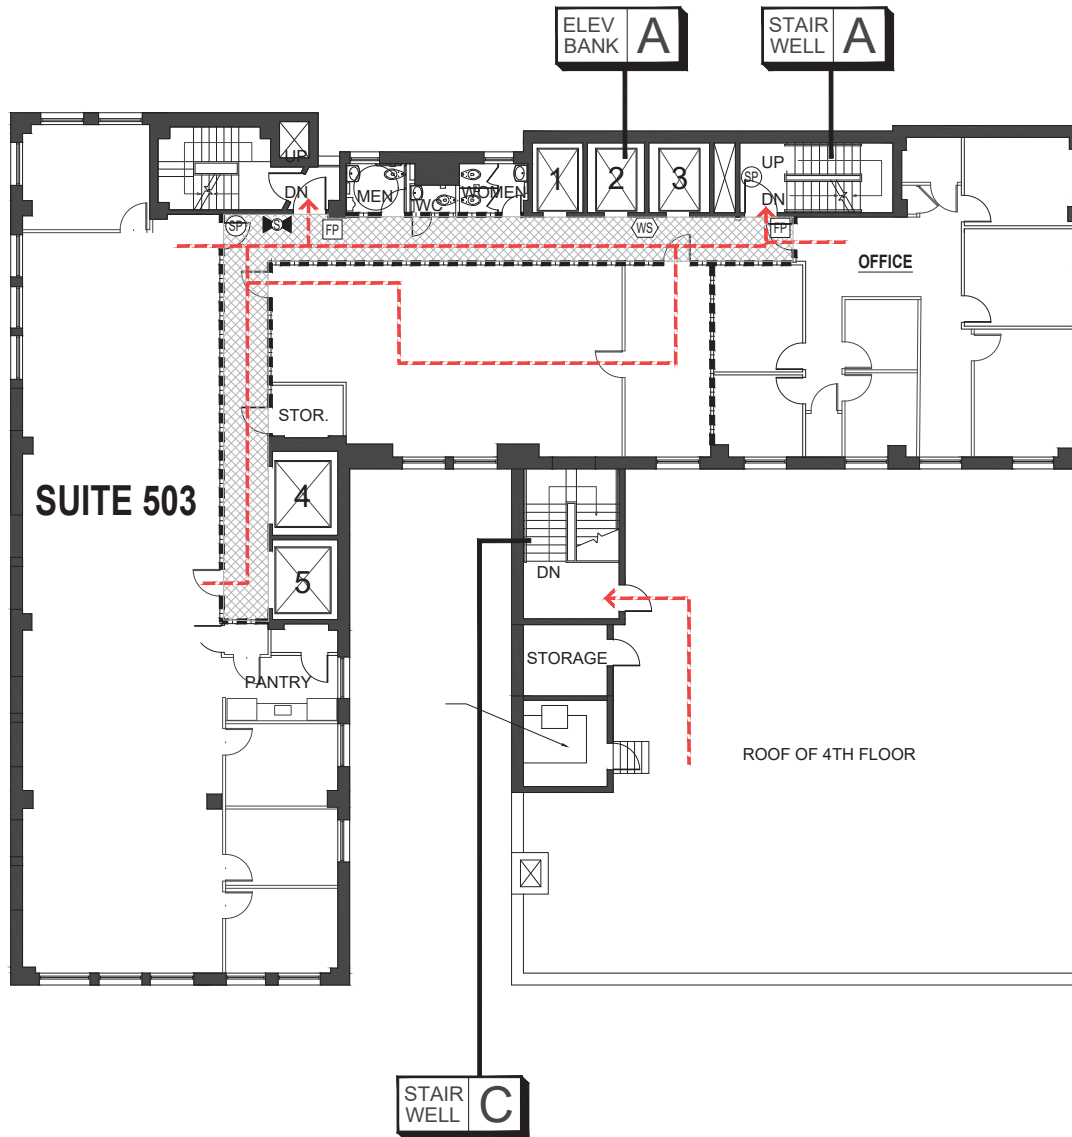

LEGEND

- FP MANUAL PULL STATION
- SP STANDPIPE HOSE OUTLET
- WS FIRE WARDEN STATION
- FCS FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- 1-HR FIRE BARRIER
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE	NAME	ISSUED/ COMMENTS
1	11.04.21	JW	REVISED PER SURVEY 10.08.21 ISSUED FOR REVIEW AND FILING

DRAWN BY/DATE: KM

CHECKED BY/DATE: DL

BUILDING ADDRESS:
350 SEVENTH AVE.
NEW YORK, NY 10001

DRAWING TITLE:
FL-5
5TH FLOOR

SURVEY BY: KM

SURVEY DATE(S): 10.08.21

WEST 29TH STREET

NOTE: FULL SPRINKLER COVERAGE