



### LEGEND

- MANUAL PULL STATION
- STANDPIPE HOSE OUTLET
- FIRE WARDEN STATION
- FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)


NO.	DATE:	NAME:	ISSUED/ COMMENTS:
1	10.01.20	MB	REVISED PER SURVEY 09.15.20 ISSUED FOR REVIEW AND FILING
2	10.08.20	JW	REVISED PER COMMENTS ISSUED FOR REVIEW

DRAWN BY/DATE: KM      CHECKED BY/DATE: DL

BUILDING ADDRESS:  
**150 WEST 30TH ST**  
**NEW YORK, NY 10001**

DRAWING TITLE:  
**FL-19**  
**19TH FLOOR**

SURVEY BY: AR      SURVEY DATE(S): 09.15.20

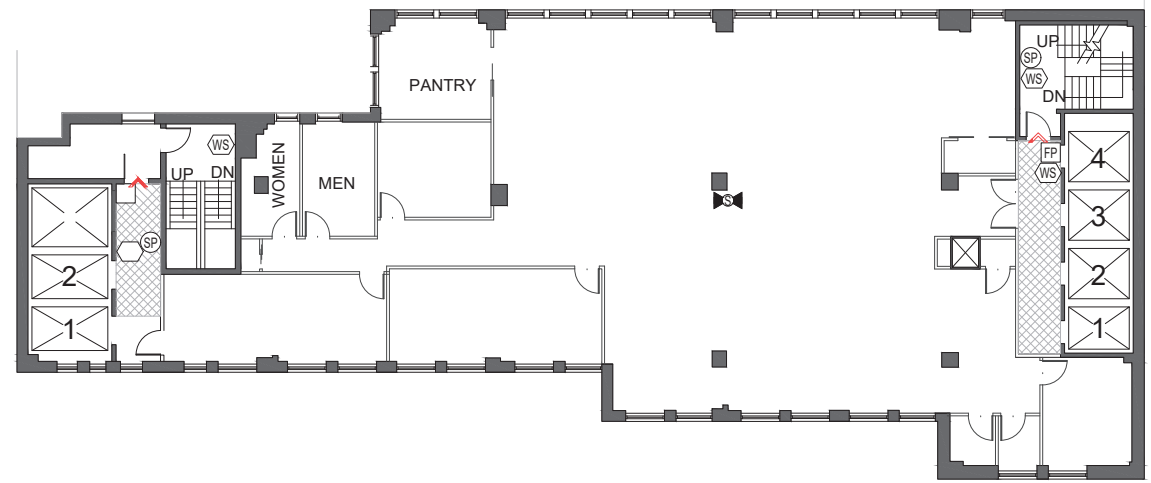

WEST 30TH STREET

NOTE: FULL SPRINKLER COVERAGE